


3SE-L – .75 HP

2" Spherical Solids Handling - Single Seal

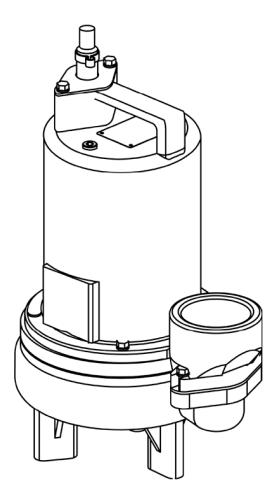

BARNES


Specifications

DISCHARGE:	3" NPT, Female, vertical				
SPEED:	1750 RPM (Nominal)				
LIQUID TEMPERATURE:	104°F (40°C) Continuous				
MOTOR HOUSING:	Cast iron ASTM A-48, class 30				
IMPELLER:	 Design: 2 Vane, open, with pump out vanes on back side. Dynamically balanced, ISO G6.3 Material: Cast iron ASTM A-48, class 30 				
CORD ENTRY:	30 ft. (9.1m) Cord. Plug on 120 Volt & .5HP. 240 Volt 1 Phase. Quick connect custom molded for sealing and strain relief				
SINGLE PHASE:	Permanent split capacitor (PSC) includes overload protection in motor				
THREE PHASE:	200-240/480 is Tri-Voltage. 600V. Requires overload protection to be included in control panel				
MOTOR:	Design:NEMA L -single phase, NEMA B -three phase torque curve, oil filled, squirrel cage induction Insulation:Class B & Class F on selected models				
UPPER BEARING:	Design: Single row, ball Lubrication: Oil Load: Radial				
LOWER BEARING:	Design: Single row, ball Lubrication: Oil Load: Radial & thrust				
VOLUTE:	Cast iron ASTM A-48, class 30				
SHAFT:	416 Stainless steel				
SQUARE RINGS:	Buna-N				
HARDWARE:	300 Series stainless steel				
PAINT:	Air dry enamel				
SEAL PLATE	Cast iron ASTM A-48, class 30				
SEAL KIT P/N:	130180				
SERVICE KIT P/N:	130207				

CRANE PUMPS & SYSTEMS

BARNES



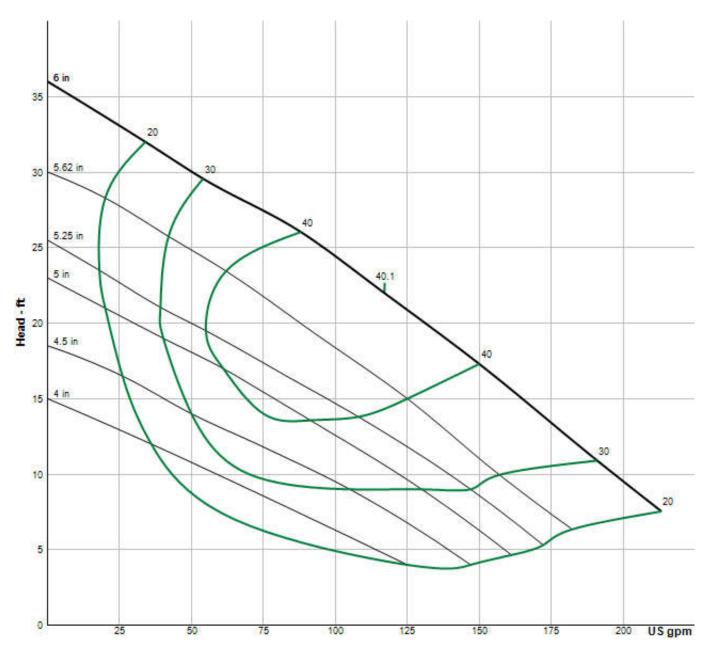

Pump HP	Impeller Dia mm (in.)		
0.5	133 (5.25)		
0.75	143 (5.62)		
1.00	152 (6.00)		



Model Information

PUMP MODEL NUMBER	3SE774L	3SE794L	3SE744L	3SE754L
PART NUMBER	104902	104903	104904	104905
HP	0.75	0.75	0.75	0.75
VOLTAGE/PHASE	200-240/1	200-240/3	480/3	600/3
HZ	60	60	60	60
RPM (NOMINAL)	1750	1750	1750	1750
NEMA START CODE	G/K	H/K	к	L
INSULATION CLASS	F	В	В	В
FULL LOAD AMPS	7.4/7.0	4.8/4.5	2.2	1.5
LOCKED ROTOR AMPS	21.5/25.8	13.7/15.4	7.7	7.2
CORD SIZE	14/3	14/4	14/4	14/4
CORD TYPE	SOW	SOW	SOW	SOW
CORD O.D INCH (MM)	0.530 (13.5)	0.570 (14.5)	0.570 (14.5)	0.570 (14.5)
WEIGHT (LBS)	85	85	85	85

IMPORTANT


Ð


1.) PUMP MAY BE OPERATED "DRY" FOR EXTENDED PERIODS WITHOUT DAMAGE TO MOTOR AND/OR SEALS. 2.) INSTALLATIONS SUCH AS DECORATIVE FOUNTAINS OR WATER FEATURES PROVIDED FOR VISUAL ENJOYMENT MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE ANSI/NFPA 70 AND/OR THE AUTHORITY HAVING JURISDICTION. THIS PUMP IS NOT INTENDED FOR USE IN SWIMMING POOLS, RECREATIONAL WATER PARKS, OR INSTALLATIONS IN WHICH HUMAN CONTACT WITH PUMPED MEDIA IS A COMMON OCCURRENCE.

CRANE PUMPS & SYSTEMS



Drawings

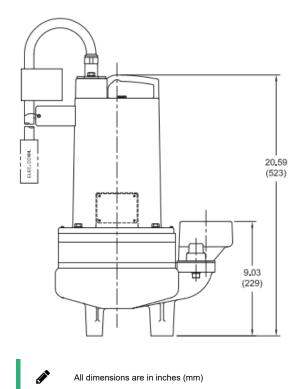



CRANE PUMPS & SYSTEMS